


- NOTES:
1. SECURE MI HEATING CABLE TO SAMPLE TUBES USING TIE WIRE OR SIMILAR METHOD.
 2. TRACE VALVES USING ACCEPTED METHODS. HEAT TRANSFER COMPOUND CAN BE USED IF DESIRED.
 3. INSULATE WITH 1" MINIMUM HI-TEMPERATURE FIBERGLASS INSULATION OR EQUIVALENT.
 4. WEATHERPROOF ALL INSULATION.
 5. MI HEATING CABLE CAN BE ROUTED ALONG STEAM LINE BETWEEN VALVES AS SHOWN. DO NOT ROUTE HEATER IN AREA SUBJECT TO MECHANICAL DAMAGE.

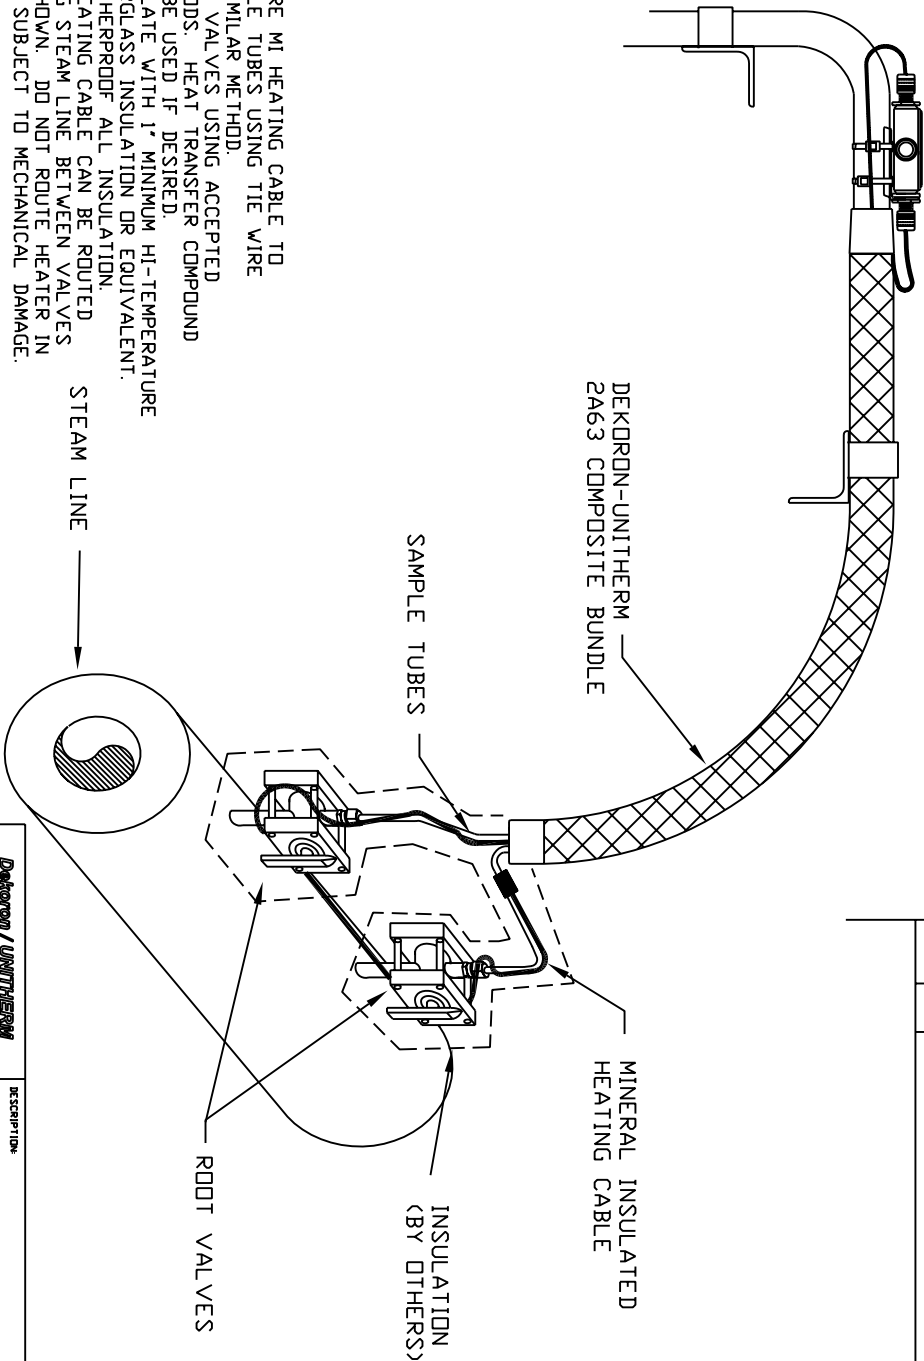

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED

Dekoron / UNITHERM		DESCRIPTION:	
HEAT CONTROL PRODUCTS 1531 COMMERCE CREEK BLVD. CAPE CORAL, FL 33909		INSTALLATION DETAIL - COMPOSITE BUNDLE WITH TWO ROOT VALVES	

EGD	BY	DATE	SCALE	SHEET
JES	B	10/22/04	B	
THIS DOCUMENT CONTAINS INFORMATION PROPRIETARY TO DEKORON/UNITHERM AND IS FURNISHED ON THE EXPRESS CONDITION THAT THE INFORMATION CONTAINED HEREIN WILL NOT BE USED FOR SECOND SOURCE PROCUREMENT OR ON DIRECTLY OR INDIRECTLY TO THE INTERESTS OF DEKORON/UNITHERM. COMPANY SOON ALL RIGHTS RESERVED		SIZE	FSCM NO.	DWG NO.
DRAWN		REV		